

Bologna, 28/01/2016

Messrs

*LAPITEC S.p.a*  
*Via Bassanese, 6*  
*31050 Veduggio (TV)*

## TEST LABORATORY

### TEST REPORT No. 2110/16

Requested by:	LAPITEC S.p.a Via Bassanese, 6 31050 Veduggio (TV)
On (date):	18/01/16
For the sample marked:	"Lapitec Sintered Stone DUNE"

**The results reported relate only to the samples tested.**

**No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision.**

**The reproduction of this test report is only authorized in the form of a complete photographic facsimile.**

**Our written approval is necessary for any partial reproduction.**

**This test report consists of 3 pages this cover included.**



# CENTRO CERAMICO

Test Report No. 2110/16

Date 28/01/2016

Page 2 of 3

Description of the sample:	Lastre di materiale lapideo 50x120x1,2 cm contrassegnato "Lapitec Sintered Stone DUNE" .
Manufacturer:	-----
Sampling details	
- Where:	-----
- Date:	-----
- By whom:	CUSTOMER
- How (methods):	-----
Date of receipt in laboratory:	19/01/16

## TESTS PERFORMED :

			Date of starting	Date of ending
<input checked="" type="checkbox"/>	DIN 51130 (06/2004)	Determination of the anti - slip properties – Workrooms and fields of activities with raised slip danger, walking method – ramp test	22/01/16	22/01/16

**DIN 51130 (06/2004)- Determination of the anti - slip properties – Workrooms and fields of activities with raised slip danger, walking method – ramp test**

Surface characteristics

☐ Smooth


☒ Profiled

☐ Structured

☒ Rough

**OPERATIVE CONDITIONS**

Fixing scheme

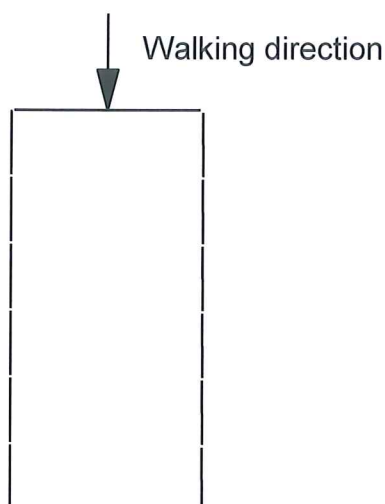

**RESULTS**

Average total acceptance angle:

**13.5°**

Movement area (cm<sup>3</sup>/dm<sup>2</sup>):

---

**CLASSIFICATION (BGR 181- 10/2003)**

Group of anti - slip properties:

**R10**

Movement area evaluation group:

---

Pietro Bruzzi  
Technical verification

Prof. Maria Chiara Bignozzi

Director

