

Bologna, 28/01/2016

Messrs

*LAPITEC S.p.a*  
*Via Bassanese, 6*  
*31050 Veduggio (TV)*

## TEST LABORATORY

### TEST REPORT No. 2114/16

Requested by:	LAPITEC S.p.a Via Bassanese, 6 31050 Veduggio (TV)
On (date):	18/01/16
For the sample marked:	"Lapitec Sintered Stone LITHOS"

**The results reported relate only to the samples tested.**

**No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision.**

**The reproduction of this test report is only authorized in the form of a complete photographic facsimile.  
Our written approval is necessary for any partial reproduction.**

**This test report consists of 3 pages this cover included.**



## CENTRO CERAMICO

Test Report No. 2114/16

Date 28/01/2016

Page 2 of 3

Description of the sample:	Lastre di materiale lapideo 50x120x1,2 cm contrassegnato "Lapitec Sintered Stone LITHOS" .
Manufacturer:	-----
Sampling details	
- Where:	-----
- Date:	-----
- By whom:	CUSTOMER
- How (methods):	-----
Date of receipt in laboratory:	19/01/16

### TESTS PERFORMED :

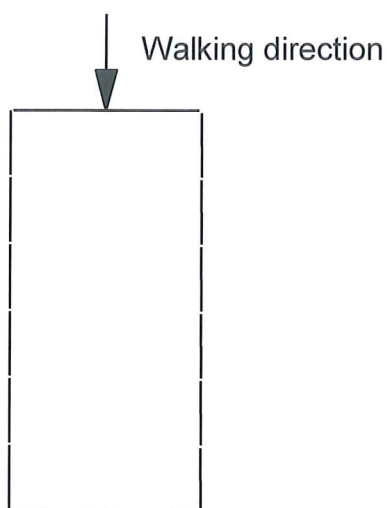
<input checked="" type="checkbox"/>	DIN 51097 (92)	Slip resistance	Date of starting	Date of ending
			28/01/16	28/01/16

**DIN 51097 (92) - Slip resistance**

- Size of the tested surface (m) 0.50 x 1.20
- Joint width (mm): ---
- Grout: ---

**OPERATIVE CONDITIONS**

Fixing scheme

**RESULTS**

- Average slip angle:

**19°****CLASSIFICATION (BGI/GUV-I 8527- 2010)**

- Evaluation group:

**A+B**

Pietro Bruzzi  
Technical verification



Prof. Maria Chiara Bignozzi

Director

