

Bologna, 28/01/2016

Messrs

LAPITEC S.p.a
Via Bassanese, 6
31050 Veduggio (TV)

TEST LABORATORY

TEST REPORT No. 2111/16

Requested by:	LAPITEC S.p.a Via Bassanese, 6 31050 Veduggio (TV)
On (date):	18/01/16
For the sample marked:	"Lapitec Sintered Stone LITHOS"

The results reported relate only to the samples tested.

No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision.

The reproduction of this test report is only authorized in the form of a complete photographic facsimile.

Our written approval is necessary for any partial reproduction.

This test report consists of 3 pages this cover included.



CENTRO CERAMICO

Test Report No. 2111/16

Date 28/01/2016

Page 2 of 3

Description of the sample:	Lastre di materiale lapideo 50x120x1,2 cm contrassegnato "Lapitec Sintered Stone LITHOS" .
Manufacturer:	-----
Sampling details	
- Where:	-----
- Date:	-----
- By whom:	CUSTOMER
- How (methods):	-----
Date of receipt in laboratory:	19/01/16

TESTS PERFORMED :

<input type="checkbox"/>			Date of starting	Date of ending
<input checked="" type="checkbox"/>	DIN 51130 (06/2004)	Determination of the anti - slip properties – Workrooms and fields of activities with raised slip danger, walking method – ramp test	22/01/16	22/01/16

DIN 51130 (06/2004)- Determination of the anti - slip properties – Workrooms and fields of activities with raised slip danger, walking method – ramp test

Surface characteristics

☐ Smooth


☐ Profiled

☐ Structured

☒ Rough

OPERATIVE CONDITIONS

Fixing scheme

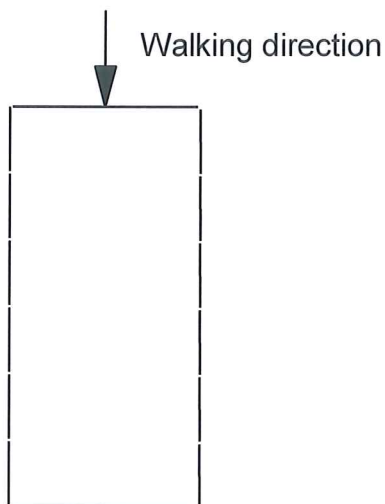

RESULTS

Average total acceptance angle:

14°

Movement area (cm³/dm²):

CLASSIFICATION (BGR 181- 10/2003)

Group of anti - slip properties:

R10

Movement area evaluation group:

Pietro Bruzzi

Technical verification



Prof. Maria Chiara Bignozzi

Director

