

**SEDE**

Via Martelli, 26 - 40138 **Bologna**  
Tel. (051) 534015 - Fax. (051) 530085

**CERTI.CER.**

**LABORATORIO DI ZONA**

Via Valle d'Aosta, 1 - 41049 **Sassuolo**  
Tel. e Fax. (0536) 802154

Part. IVA 0094778-0375

*Bologna,* 18/10/13

Spett.le  
LAPITEC S.p.A.  
Via Bassanese, 6  
31050 VEDELAGO (TV)

**TEST LABORATORY**

**TEST REPORT No. 6446/13**

(translation of Test Report No. 6384/13 of 16/10/13)

Requested by:	LAPITEC S.p.A. Via Bassanese, 6 31050 VEDELAGO (TV)
On (date):	08/10/13
For the sample marked:	"LAPITEC COLLECTION VESUVIO".

The results reported relate only to the samples tested.

No responsibility is taken for the accuracy of the sampling unless it is done under our supervision.

The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction.

This test report consists of 3 pages this cover included.



Consorzio universitario per la gestione del  
"Centro di ricerca e sperimentazione per  
l'industria ceramica".  
D.P.R. 10-4-1978 n. 806  
(G.U. 20-12-1978 n. 353)

Laboratorio autorizzato ad effettuare il  
servizio di rilevamento dell'inquinamento  
atmosferico.  
Decreto MINISTERO SANITÀ 10-8-1974  
(G.U. 14-9-1974 n. 240)

Laboratorio iscritto nell'albo dei "Laboratori Esterni  
Pubblici e Privati Altamente Qualificati".  
Decreto MINISTERO RICERCA SCIENTIFICA 6-6-1983  
(G.U. 6-7-1983 n. 183)

Membro ASTM  
American Society for  
Testing and Materials.

## Description of the sample:

Slab 50 x 120 cm marked "LAPITEC COLLECTION  
VESUVIO".

Manufacturer: -----.

## Sampling details:

- Where: -----  
- Date: -----  
- By whom: CUSTOMER  
- How (methods): -----

DATE OF RECEIVAL IN LABORATORY: 11/10/13

## TESTS PERFORMED:

		Date of starting	Date of ending
<input checked="" type="checkbox"/>	DIN 51097 (92) Slip resistance	14/10/13	14/10/13


**DIN 51097 (92) - Slip resistance**

**WORKING CONDITIONS**

- Size of the tested surface (m)

0.50 x 1.20

Fixing scheme

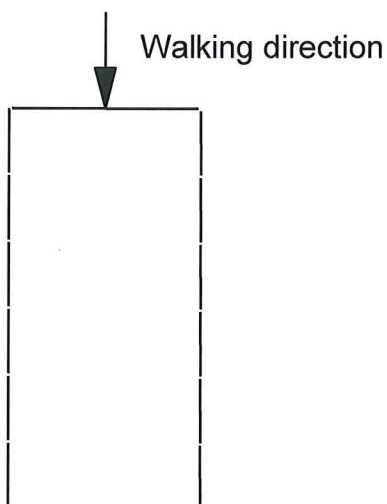

**RESULTS**

- Average slip angle:

24°

**CLASSIFICATION (BGI/GUV-I 8527- 2010)**

- Evaluation group:

A+B+C



Prof. Eng. Giorgio Timellini  
DIRECTOR